

# Integral Orifice Assembly For Very Small Flow Measurement Model KEE

## Introduction

The Integral Orifice Assembly is a compact set of orifice mechanism which is used to measure a very small flow in a very small piping. The assembly can be directly mounted on the meter body of a ST3000 or PREX Series Differential Pressure Transmitter or on that of a KFD Differential Pressure Field Mounted Controller. Six types of orifices are available to cover a wider flow range.

## Standard Specifications

### Applicable Transmitters :

ST3000 Series: JTD 210/215/220

PREX3000 Series: KDP 11/22/33/44

KFD Series: KFDB□□11/22/33/44

### Operating Pressure and Temperature Ratings :

Depends on transmitter ratings. (Depends on flange ratings when flanges with short pipes are used.)

### Mounting :

Direct mounting on top or bottom of transmitter meter body.


### Materials :

Body and orifice: SUS316

Gaskets: Teflon rings

### Piping Connections :

Rc1/2, 1/2NPT internal thread or flange connections. (In the case of thread connections, use 1/2-inch Sch 80 for piping.)

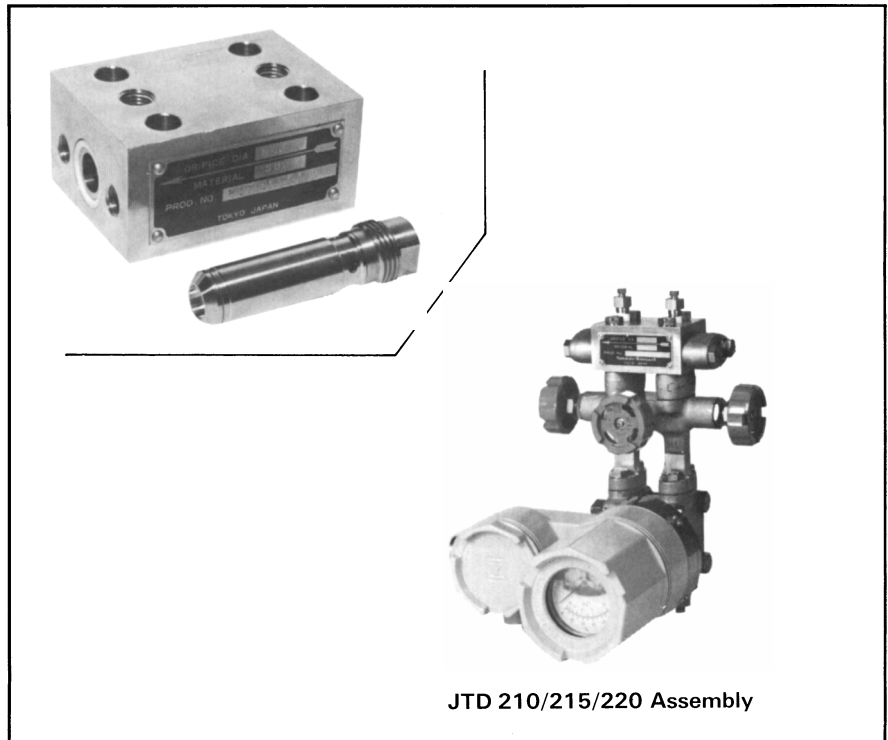

## Orifice Diameters and Accuracies

Orifice No.	Orifice Aperture Diameter (mm)	Orifice Diameter Ratio $\beta = \frac{d}{D}$	Orifice Factor $S = (\alpha \cdot \beta^2)$	Low Limit Reynolds Number $R_D$	Accuracy % FS
1	8.5	0.60729	0.32777	1600	±2
2	5.0	0.35734	0.10244	950	±2
3	2.8	0.20019	0.032492	550	±2
4	1.59	0.11382	0.010625	300	±2.5
5	0.9	0.064601	0.0034045	250	±3
6	0.5	0.036048	0.0011103	200	±4

Notes: 1) Select a Reynolds number higher than the low limit so that the orifice factor is maintained constant.

2) For gas measurement, the following conditions must be met:

$$\frac{\Delta P \text{ (mmH}_2\text{O)}}{1000 \times P \text{ (kgf/cm}^2 \text{ abs)}} \leq 1.5$$


3) Not applicable for measurement of fluid with suspension or adhesive substance.

4) The straight pipe section length requirements are identical with those of regular orifices.

## Differential Pressures and Reynolds Numbers

See the following for flow rate/differential pressure charts and Reynolds number calculation equations.

### [Liquid]

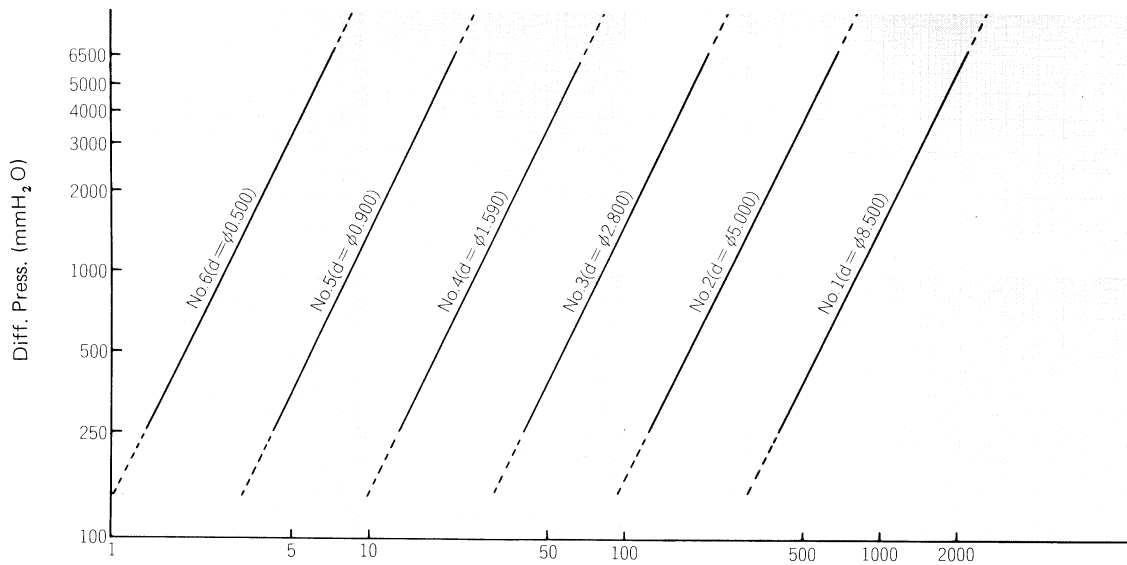

Vw: Reference Liquid Flow Rate l/hr (at 15°C, 1atm)

#### ● Conversion equation to liquid flow

$$V_w = V \times GB \times \sqrt{\frac{1}{G_o}}$$

Vw: Reference liquid flow rate (l/hr)

V: Flow of measured liquid (l/hr)

GB: Specific gravity of measured liquid at reference condition.

Go: Specific gravity of measured liquid at operating condition.

#### ● Reynolds number calculating equation

$$RD = \frac{25.2 \times V \times GB}{\mu}$$


RD: Reynolds number

V: Flow of measured liquid (l/hr)

GB: Specific gravity of measured liquid at reference condition.

$\mu$ : Viscosity (CP)

### [Gas]

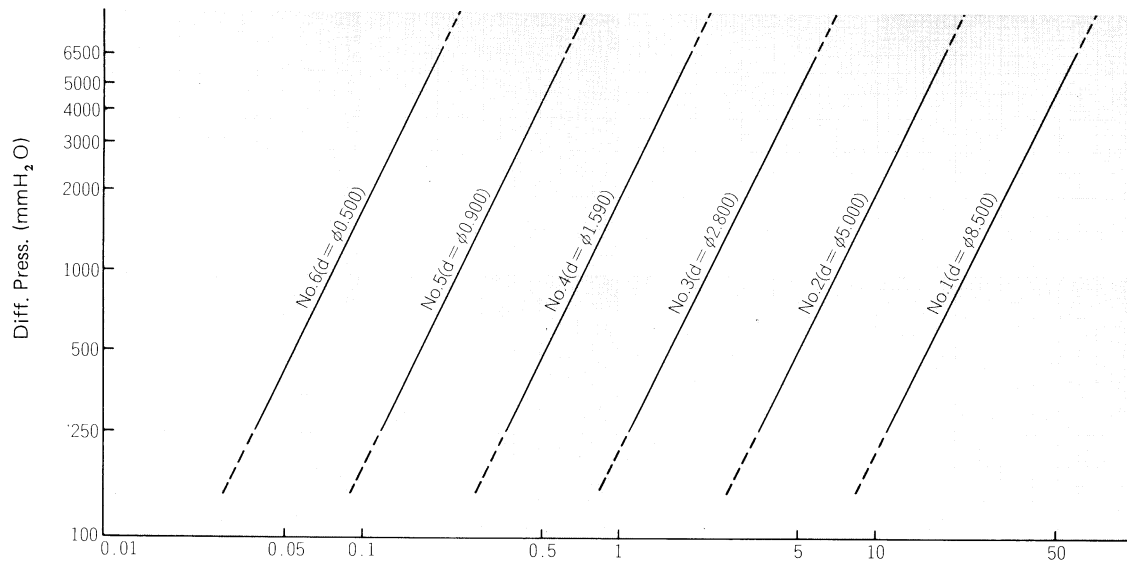

QA: Reference Gas Flow Rate Nm<sup>3</sup>/h (at 0°C, 1 atm)

#### ● Conversion equation to gas flow

$$QA: Q_n \sqrt{\frac{T}{273.2}} \times \frac{1.033}{P} \times G$$

QA: Reference gas flow rate (Nm<sup>3</sup>/hr)

Qn: Flow of measured gas (Nm<sup>3</sup>/hr)

T: Absolute temperature of measured gas (°K)

P: Absolute pressure of measured gas (kgf/cm<sup>2</sup> abs.)

G: Specific gravity of measured gas, with air as a base.

(G of air is 1)

#### ● Reynolds number calculating equation

$$RD = \frac{32.6 \times Q_n \times G}{\mu}$$

RD: Reynolds number

Qn: Flow of measured gas (Nm<sup>3</sup>/hr)

G: Specific gravity of measured gas air as a base. (G of air is 1)


$\mu$ : Viscosity (CP)

**Model Number Table**


Basic Model No.	Selections										Options	Description	
	I				II								
	Material of Plate	Material of Body	Vent/Drain Thread	Process Connections	Flanges			Type of Connecting Plane	Gasket Plane Finish	Face to Face Dimension			Materials of Flange Pipes
				Standard	Class	Diameter							
KEE													Integral orifice assembly
	-2												SUS 316
		2											SUS F 316
			A										Rc ¼
			B										¼ NPT internal thread
				T									Rc ½
				N									½ NPT internal thread
				F									With short pipe flanges
						1							JIS 10K
					-J	2							JIS 20K
						3							JIS 30K
						1							JPI 150
					-P	2							JPI 300
						3							JPI 600
						1							ANSI 150
					-A	2							ANSI 300
						3							ANSI 600
							1						15mm (½")
								R					RF
									J				Standard
										4			400mm
										5			500mm
										6			600mm
										7			700mm
											2		SUS F 316 (Short pipe: SUS316TP Sch80)
											-N		No oil finish
											-S		Mounting bolts: SUS304
											-X		No options

Note) When "T" or "N" is selected for process connections, Selection II is not required.  
Example: KEE-22AT-X


**Construction (Exploded View)**

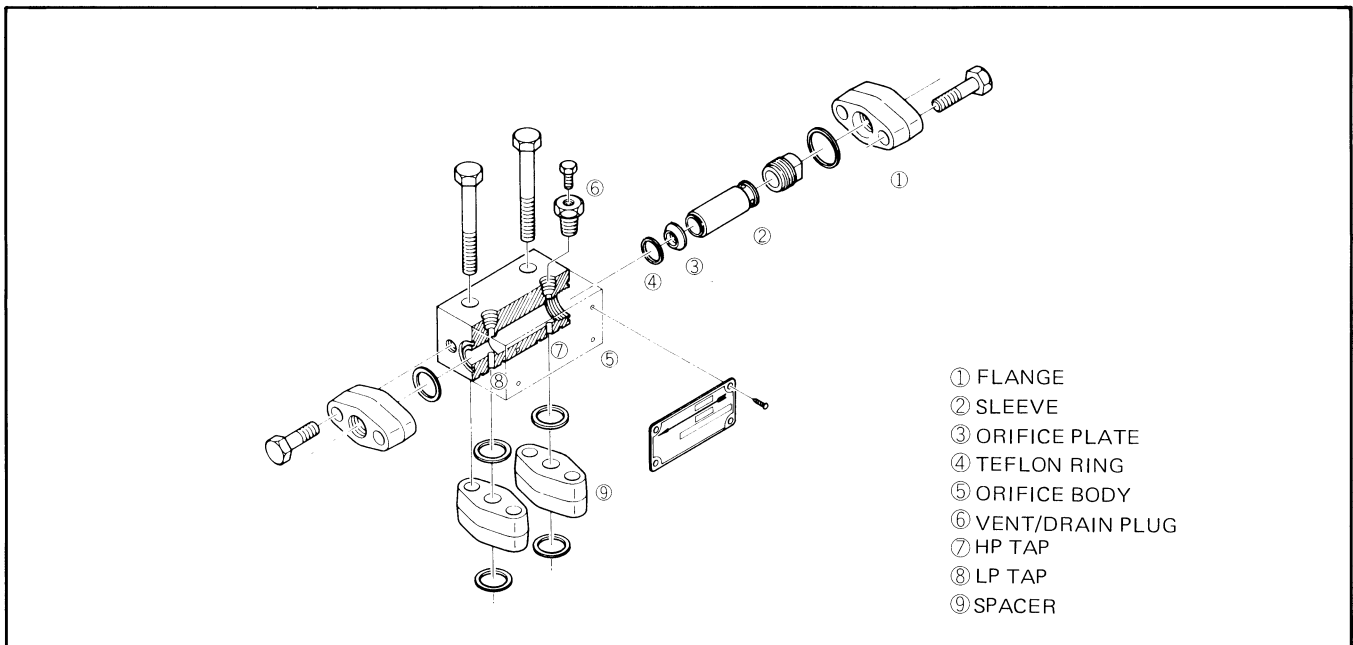


## Dimensions

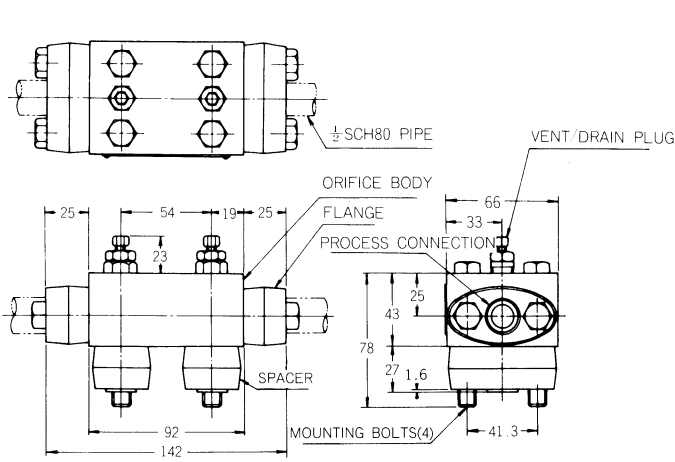

**Integral Orifice Assembly**

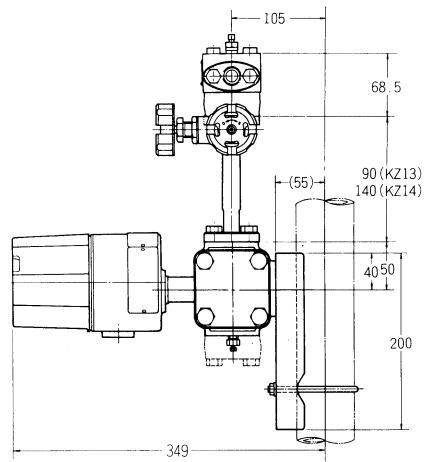


**JTD210/215/220 Assembly**

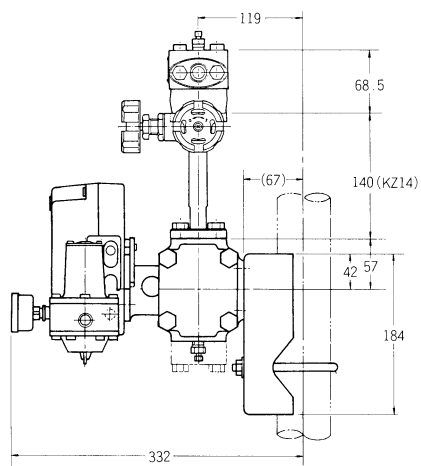

**KDP 11/22 Assembly**

Note) All assembly diagrams are with KZ14 manifold valves.

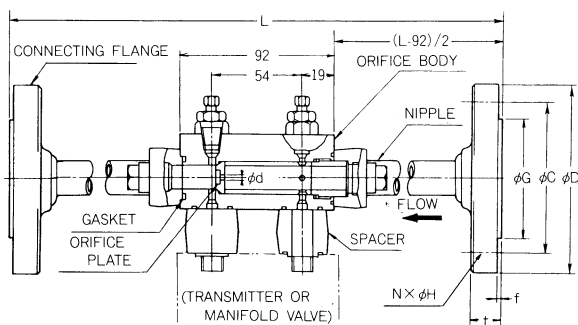

**With short pipe flange**

**Dimensions of Connecting Flange**

FLANGE RATING	$\phi D$	$\phi G$	t	f	$\phi C^{PC}$	$N \times \phi H$
15mm JIS10K RF	95	51	12	1	70	4 × 15
15mm JIS20K RF	95	51	14	1	70	4 × 15
15mm JIS30K RF	115	55	18	1	80	4 × 19
1/2" ANSI/JPI150RF	89	34.9	11.5	1.6	60.3	4 × 16
1/2" ANSI/JPI300RF	95	34.9	14.5	1.6	66.7	4 × 16
1/2" ANSI/JPI600RF	95	34.9	14.5	6.4	66.7	4 × 16

Please make sure to specify the following data for calculation before ordering.

No.	Item			Calculation symbol	Unit
1	Plate material (Standard: SUS316)			—	—
2	Name of fluid			—	—
3*1	Maximum flow rate (instrument full scale)			W	kgf/hr
				Q	m <sup>3</sup> /hr Nm <sup>3</sup> /hr
4*2	Normal flow rate			WA	kgf/hr
				QA	m <sup>3</sup> /hr Nm <sup>3</sup> /hr
5*3	Scale reference (Specify for volumetric flow)	Liquid	at 15°C or at □°C	—	—
		Gas	at 0°C, 1 atm. Measuring base for wet gas or at □°C, □kgf/cm <sup>2</sup> G	—	—
6	Normal temperature			T <sub>1</sub>	°C
7	Normal pressure			P <sub>1</sub>	kgf/cm <sup>2</sup> G mmH <sub>2</sub> O
8*3	Specific weight	Liquid	at scale reference condition	R <sub>N</sub>	kgf/m <sup>3</sup>
			at operating condition	R <sub>1</sub>	kgf/m <sup>3</sup>
	Gas	Mol weight or Specific gravity quantity at 0°C, 1 atm.	DRY or WET	MW	g/22.406ℓ
			DRY or WET	R <sub>N</sub>	kgf/Nm <sup>3</sup>
9	Normal viscosity			U	cp
10*3	Compressibility factor	Gas only	at 0°C, 1 atm.	Z <sub>N**4</sub>	—
			at operating condition	Z <sub>1</sub>	—
11*3	Relative humidity	Gas only	at operation or □°C, □kgf/cm <sup>2</sup> G	RH	%
12	Specific heat ratio	Gas only	at operating condition	IZ	—

Notes:

\*1) For the maximum flow rate in No. 3 in the table, please specify the maximum value of the instrument scale.

\*2) Unless specified otherwise by the customer, 80% of the maximum flow rate is assumed for the normal flow rate of No. 4.

\*3) Refer to the followings for conversion from volumetric flow rate to weight flow rate of No. 5, specific weight of No. 8, compressibility factor of No. 10, and relative humidity of No. 11.

(1) LIQUID  
 $W=Q_N \cdot R_N$  ..... (1)  
 $W=Q_1 \cdot R_1$  ..... (2)

(2) GAS  
 DRY BASE  

$$W = \frac{Q_N(D) \cdot R_1}{\frac{(P_1 + 1.0332) - \phi \cdot P_V}{1.0332} \cdot \frac{273.15}{T_1 + 273.15} \cdot \frac{1}{Z_R}} \quad (3)$$

WET BASE  

$$R_1 = R_N(D) \cdot \frac{P_1 + 1.0332}{1.0332} \cdot \frac{273.15}{T_1 + 273.15} \cdot \frac{1}{Z_R} \left[ 1 + \frac{\phi \cdot P_V}{P_1 + 1.0332} \left( \frac{0.6225}{G(D)} - 1 \right) \right] \quad (4)$$

TOTAL BASE  
 $W = Q_N(T) \cdot R_N(W)$  ..... (6)  
 $R_1 = R_N(W) \cdot \frac{P_1 + 1.0332}{1.0332} \cdot \frac{273.15}{T_1 + 273.15} \cdot \frac{1}{Z_R}$  ..... (7)  
 $G(D) = \frac{MW(D)}{28.97}$  ..... (8)

$$R_N(D) = \frac{1.2929 \cdot G(D)}{Z_N} \quad (9)$$

$$G(W) = \frac{MW(W)}{28.97} \quad (10)$$

$$R_N(W) = \frac{1.2929 \cdot G(W)}{Z_N} \quad (11)$$

$$Z_R = \frac{Z_1}{Z_N} \quad (12)$$

Where:

- W: Flow rate in weight unit [kgf/hr]
- Q<sub>N</sub>: Flow rate in volumetric unit at reference condition [m<sup>3</sup>/hr or Nm<sup>3</sup>/hr]
- Q<sub>1</sub>: Flow rate at operating condition [m<sup>3</sup>/hr]
- R<sub>N</sub>: Specific weight at reference condition [kgf/m<sup>3</sup> or kgf/Nm<sup>3</sup>]
- R<sub>1</sub>: Specific weight at operating condition [kgf/m<sup>3</sup>]
- P<sub>V</sub>: Saturated steam pressure [kgf/cm<sup>2</sup> abs]
- φ: Relative humidity =  $\frac{RH}{100}$
- Z<sub>R</sub>: Compressibility factor ratio.
- G: Specific gravity of gas based on air at 0°C, 1 atm. (G of air is 1)
- D, W or T in ( ) denotes DRY, WET or TOTAL, respectively.

\*4) Unless otherwise specified by the customer, 1.0 is assumed for compression factor Z<sub>N</sub> of No. 10.

\*5) When data items are omitted to be indicated by the customer but the physical property data of the mediums is well known to Yamatake Corporation, such data will be used for calculation

\*6) The adjusting range of differential pressure will be calculated referring to the above table.





Particular types of instruments as mentioned below also are available.

Please consult us.

- 1) Instruments for pressures are temperatures higher than those of standard specifications.
- 2) Instruments made of special materials (monel, tantalum, titanium or hastelloy C) other than those of standard specifications.
- 3) Special types of connections
- 4) Others

Please read the "Terms and Conditions" from the following URL before ordering or use:

<http://www.azbil.com/products/bi/order.html>

*Specifications are subject to change without notice.*

**azbil**

## Azbil Corporation

Advanced Automation Company

1-12-2 Kawana, Fujisawa

Kanagawa 251-8522 Japan

URL: <http://www.azbil.com/>

6th edition: Jan. 2013

*No part of this publication may be reproduced or duplicated without the prior written permission of Azbil Corporation.*